





ALTERNATOR, 24V 42A

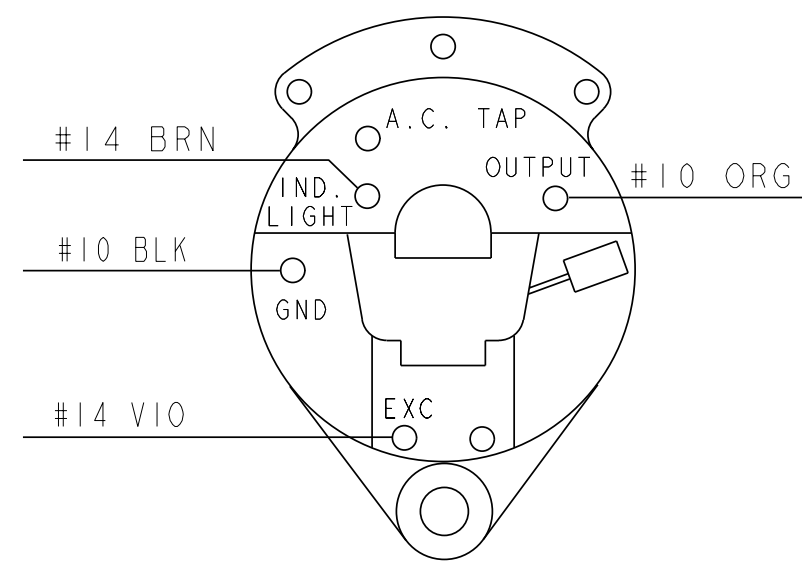

ALTERNATOR, 12V 51A

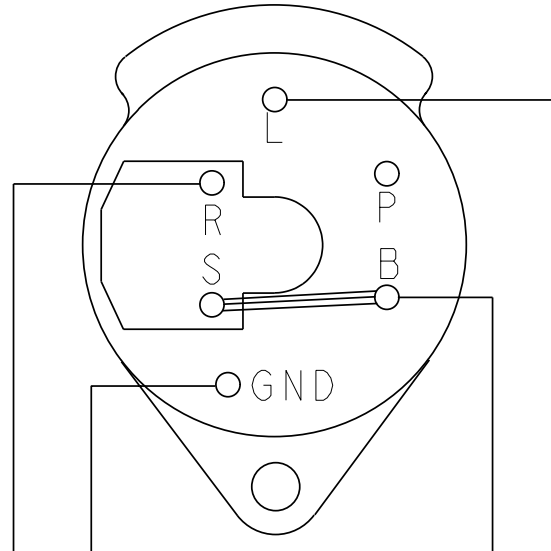

ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY	ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY
6595	1-26-2009	E	UPDATE TITLE BOX WITH 45-95 BEDA MODEL.		GA	5121	11/19/01	A	GAUGES CHANGED, REWIRED INSTRUMENT PANEL CORRECTED SCHEMATIC		JRS
5767	6/22/04	B	ADD OVERSPEED BOARD		GA	5861	11/2/04	C	ADDED JUMPER BETWEEN TB2-6&7; K2-86 WAS CONNECTED TO TB2-6;		GA
6179	3/20/2008	D	RELOCATED #14 YEL TB2-7 TO TB2-9		RPS						

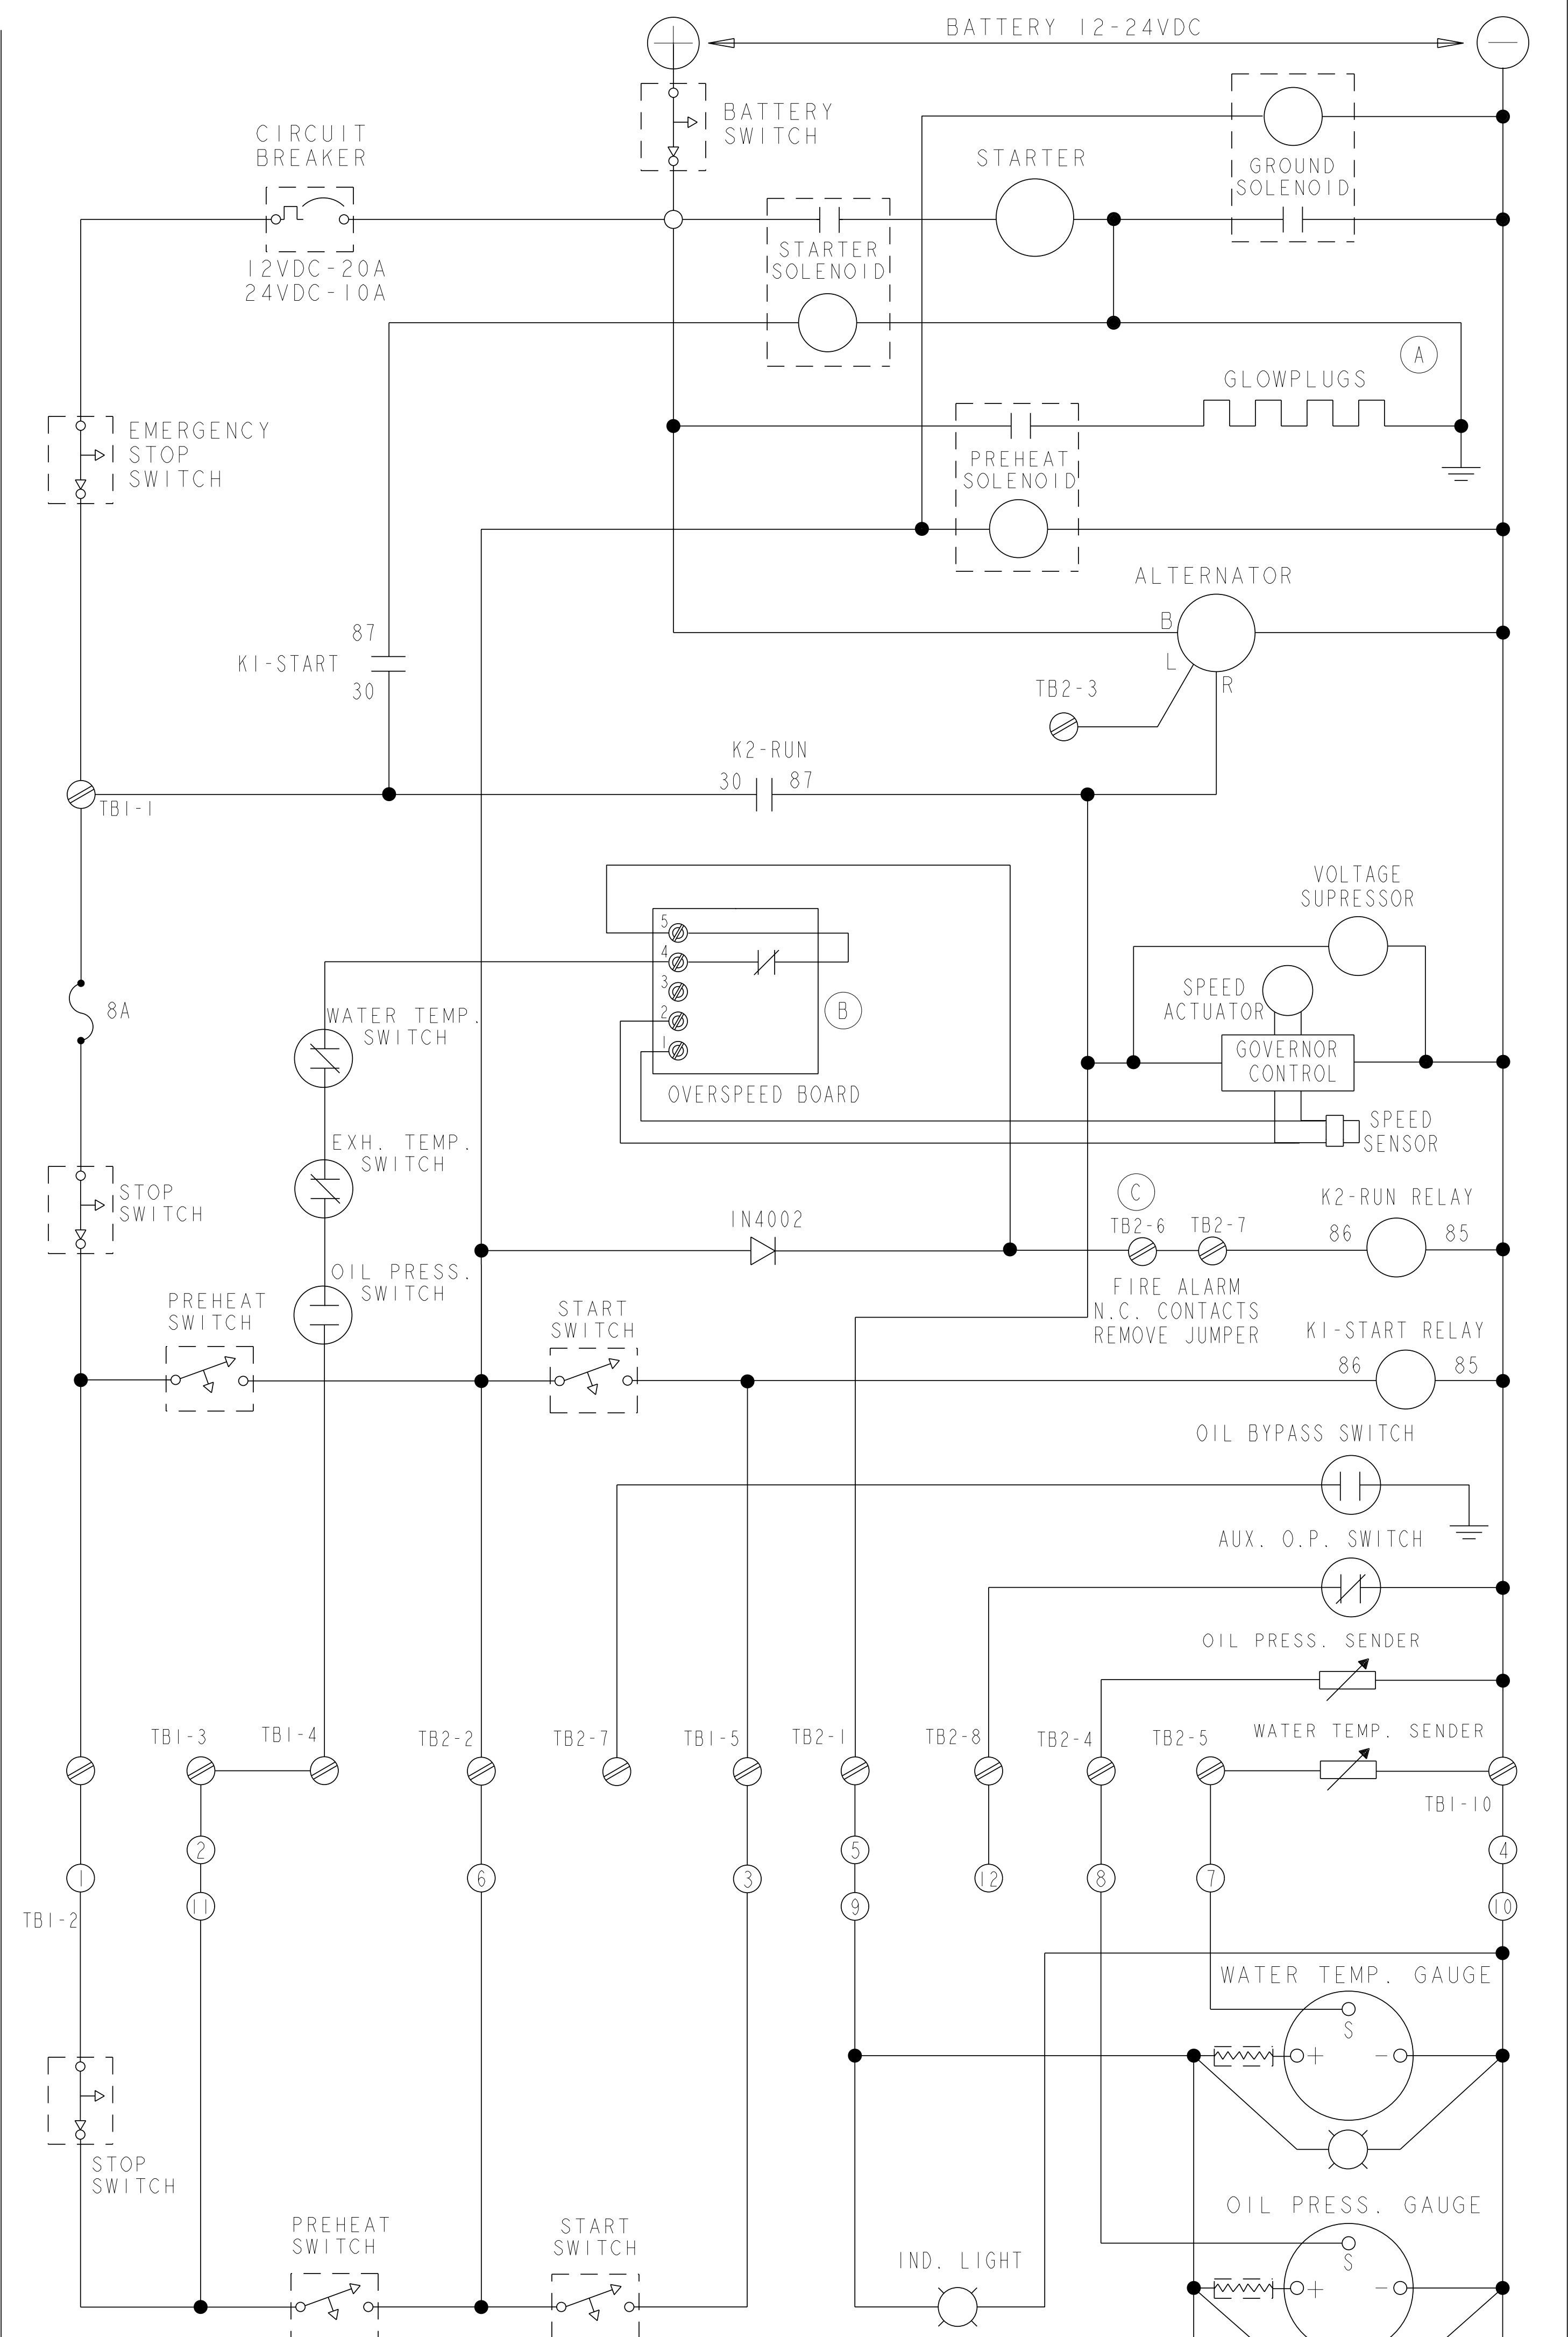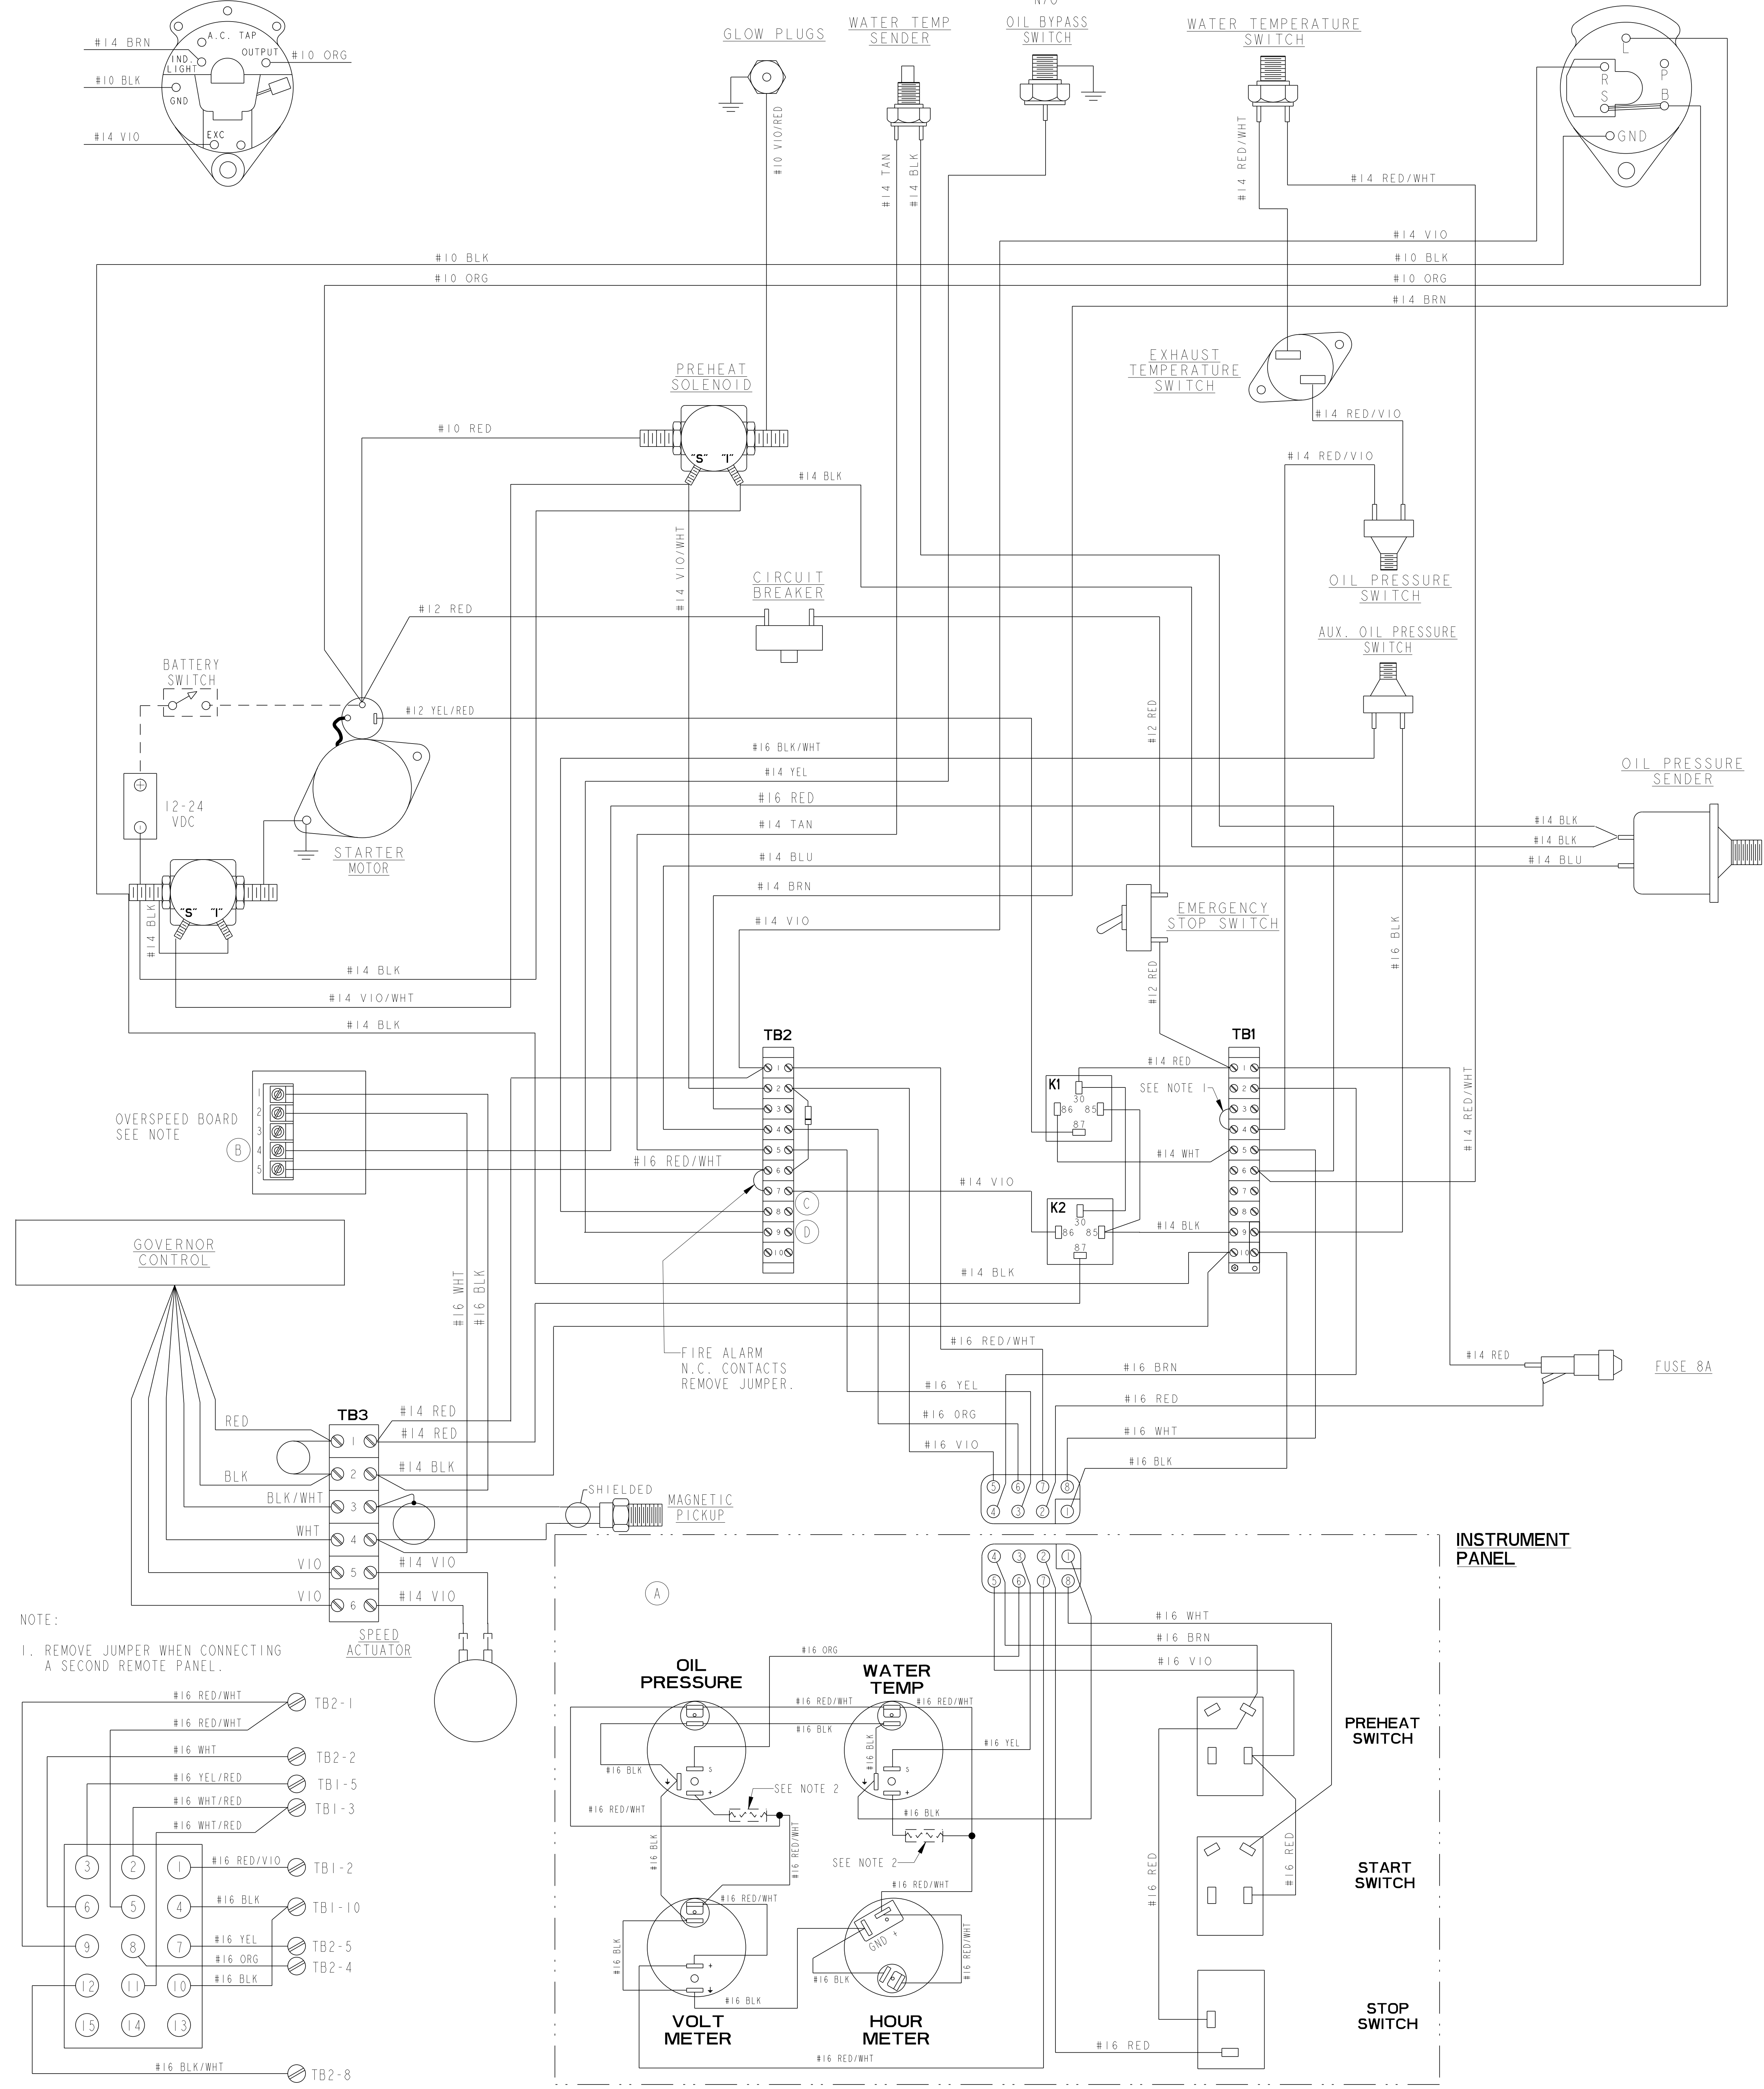

- NOTE:**
- 1. REMOTE CONECTOR PINS
 - 2. FOR 24 VOLT SYSTEM, USE 150Ω RESISTOR AS SHOWN.
 - 3. JUMPER SETTING:
J1 OPEN - 50HZ
J2 CLOSE - 60HZ
J3 OPEN - 5-15KW
J4 CLOSE - 20-95KW

TOLERANCES (UNLESS OTHERWISE NOTED)		WESTERBEKE CORPORATION AVON, MA. 02322	
INCHES	MILLIMETERS	TITLE	
.XX : .02	.X :	WIRING DIAGRAM/SCHEMATIC	
.XXX : .005	.XX :	45.0-95.0 BEDA/A - UNGROUNDED	
ANGLES : 1/2	FINISH : S	DRAWN BY	DATE
		Jeremy Anderson	16/Jan/01
DIMENSIONS		APPROVED BY	DATE
(WHEN APPLICABLE)			
SCALE	SIZE	DRAWING NUMBER	REV.
1/8" = 1"	11.0 x 17.0		
SHEET 1 OF 1		E	45673