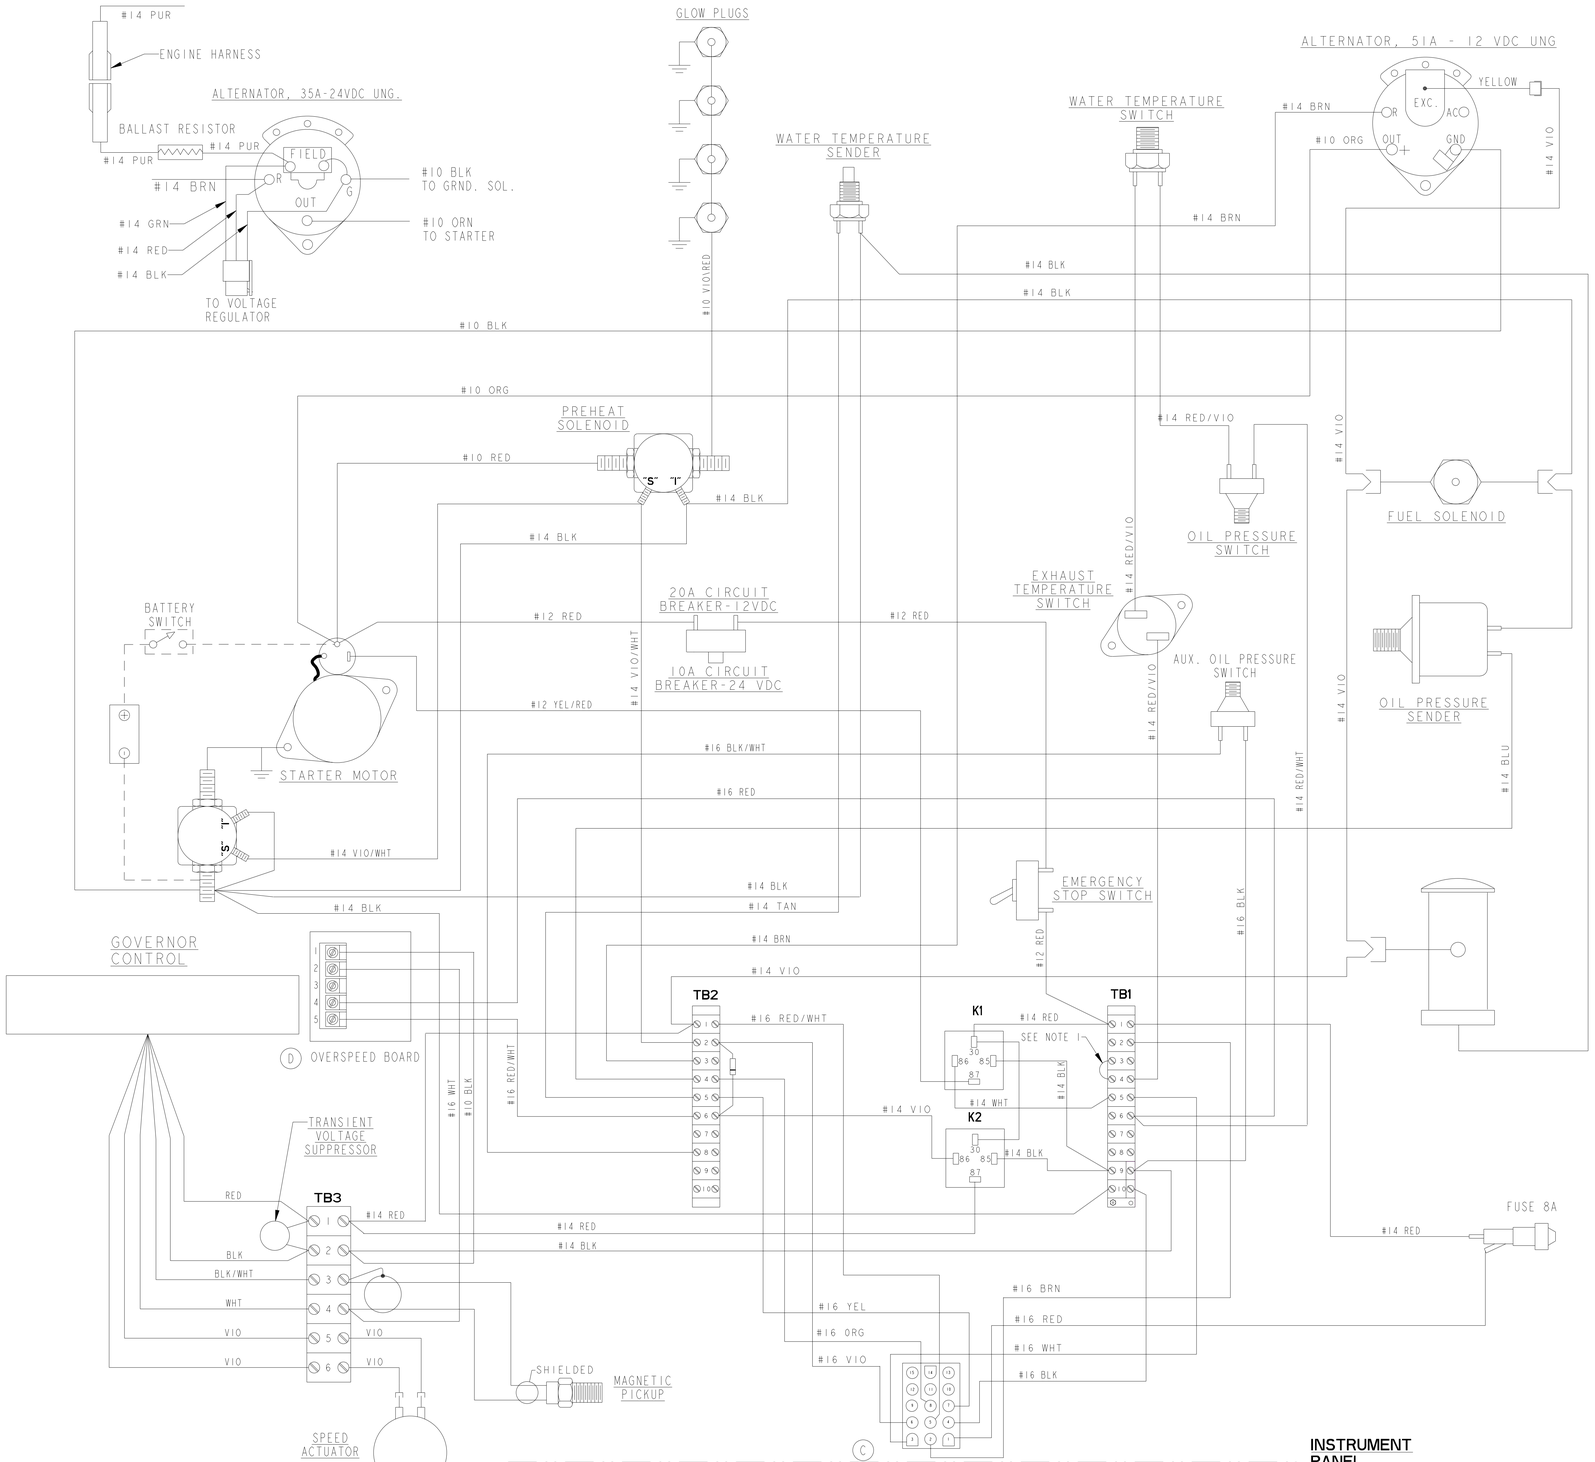

NOTE:

1. REMOVE JUMPER WHEN CONNECTING A SECOND REMOTE PANEL.

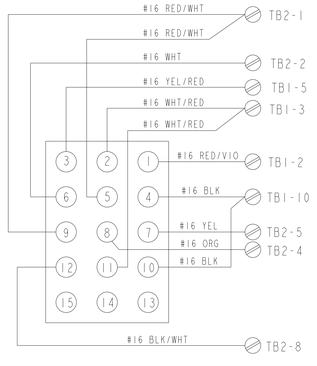

INSTRUMENT PANEL

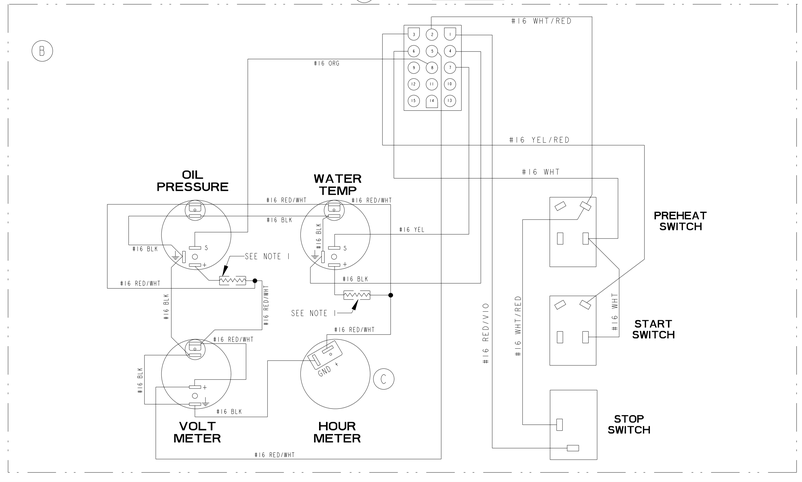

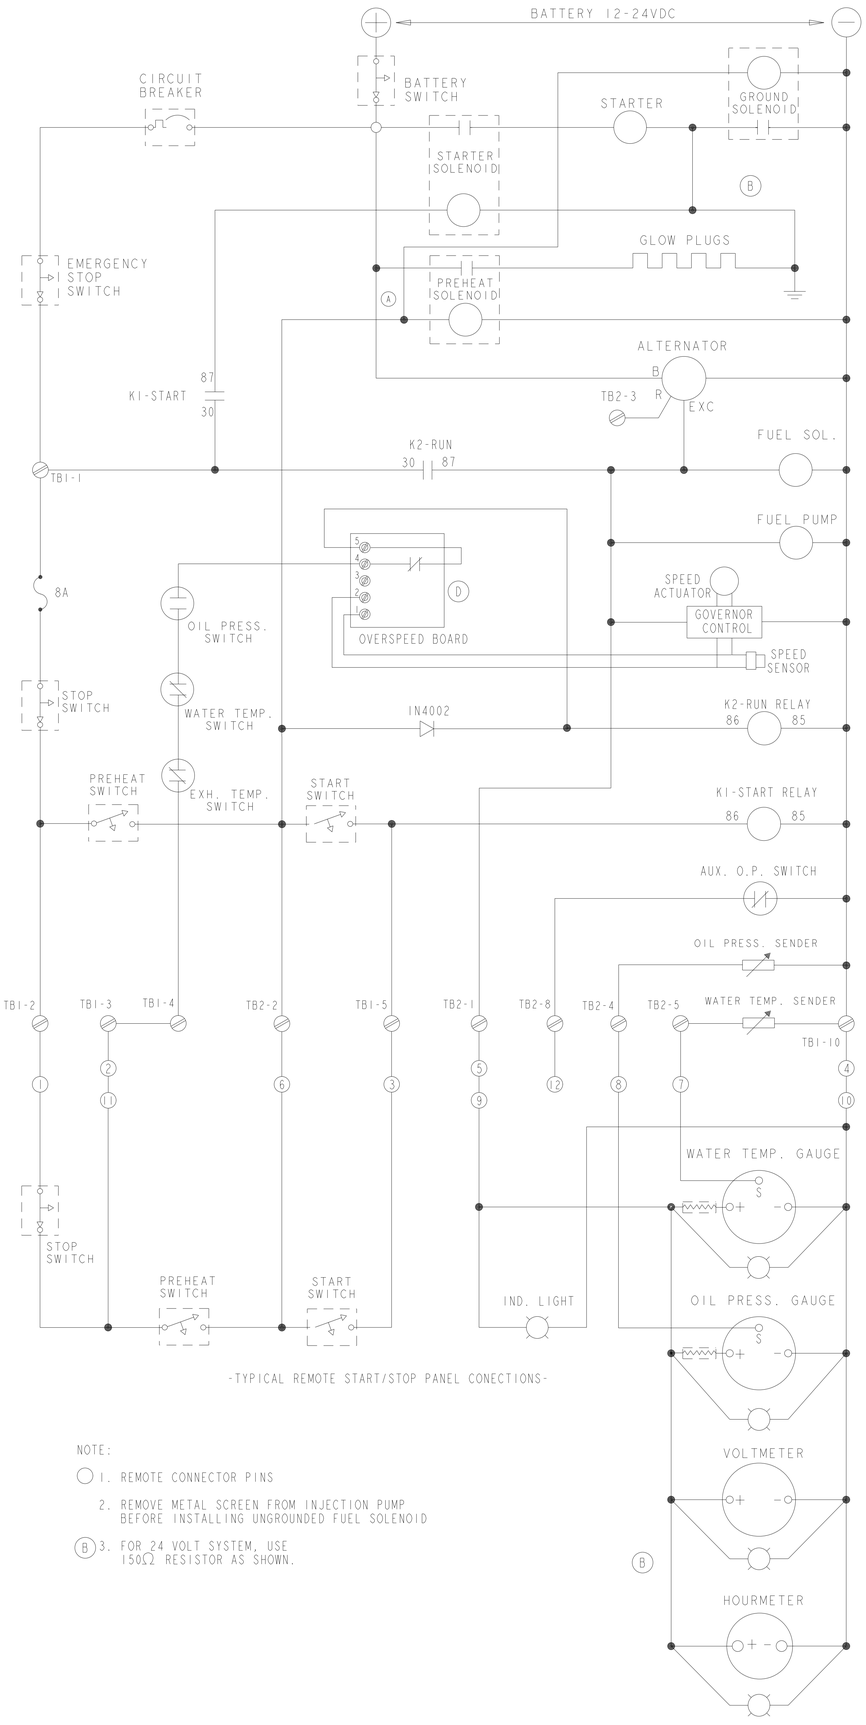

-TYPICAL REMOTE START/STOP PANEL CONECTIONS-

NOTE:

1. REMOTE CONNECTOR PINS
2. REMOVE METAL SCREEN FROM INJECTION PUMP BEFORE INSTALLING UNGROUNDED FUEL SOLENOID
3. (B) FOR 24 VOLT SYSTEM, USE 150Ω RESISTOR AS SHOWN.

ECO NO.	DATE	REV.	REVISION RECORD	AUTH.
5536	4-25 2003	D	ADDED OVERSPEED BOARD	GA
5384	10/17 02	C	15 PINS CONNECTOR WAS 8 PINS; REMOVED CONNECTORS FROM HOUR METER ON INSTRUMENT PANEL	GA
5121	11/19 01	B	GAUGES CHANGED; REWIRED INSTRUMENT PANEL CORRECTED SCHEMATIC	JRS
4777	8/17 01	A	UPDATED WIRING FOR GROUND SOLENOID	JH

TOLERANCES (UNLESS OTHERWISE NOTED)
INCHES: XX ± .02, XXX ± .005, CAST ± .03, ANGLES ± .5°, FINISH
MILLIMETERS: X ± .5, .XX ± .13
DIMENSIONS: INCHES / MILLIMETERS (WHEN APPLICABLE)

WESTERBEKE CORPORATION
AVON MA. 02322

TITLE: WIRING DIAGRAM/SCHEMATIC,20.0 BEDA
25.0 BED, 12-24VDC UNGROUNDED - SRC

DRAWN BY	DATE	MATERIAL
MPG	16/Mar/00	-
APPROVED BY	DATE	-
SCALE NONE	SIZE E	DRAWING NUMBER 44808
SHT. 1 OF 1		REV. D