



CONTROL BOX (AC SIDE)

TERMINAL BLOCK CONNECTIONS SHOWN ARE CONFIGURED FOR PARALLEL-WYE 190/208 VAC REFER TO 53328 FOR OTHER AC WIRING


TERMINAL BLOCK

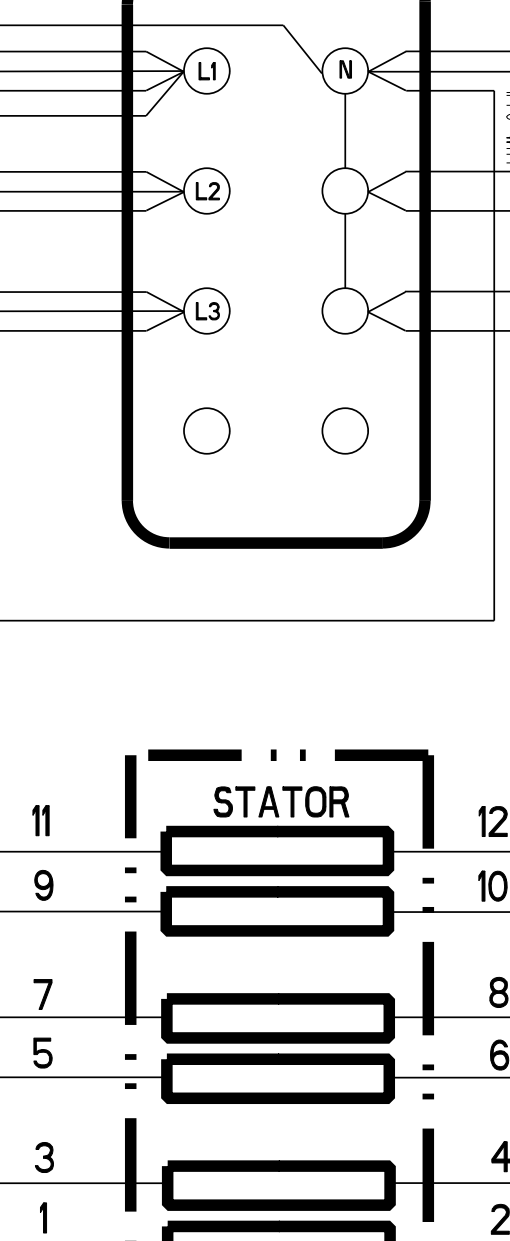


AVR

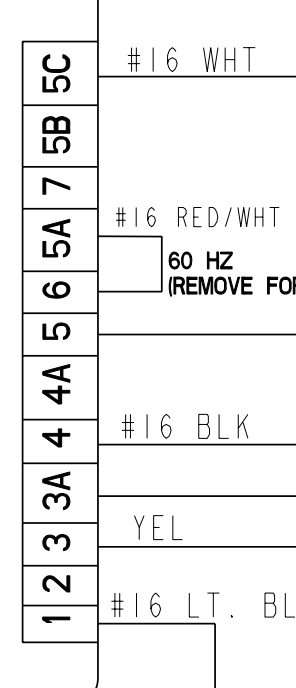



EXCITER

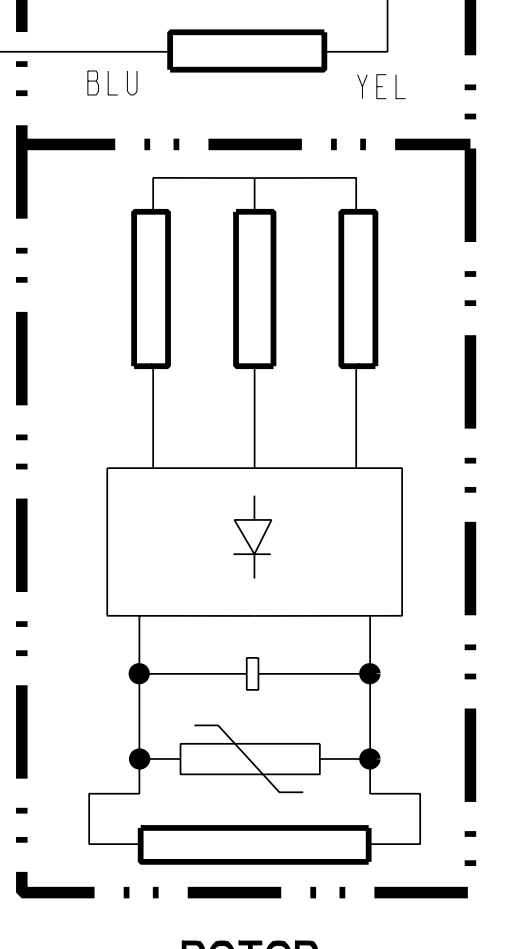

ROTOR

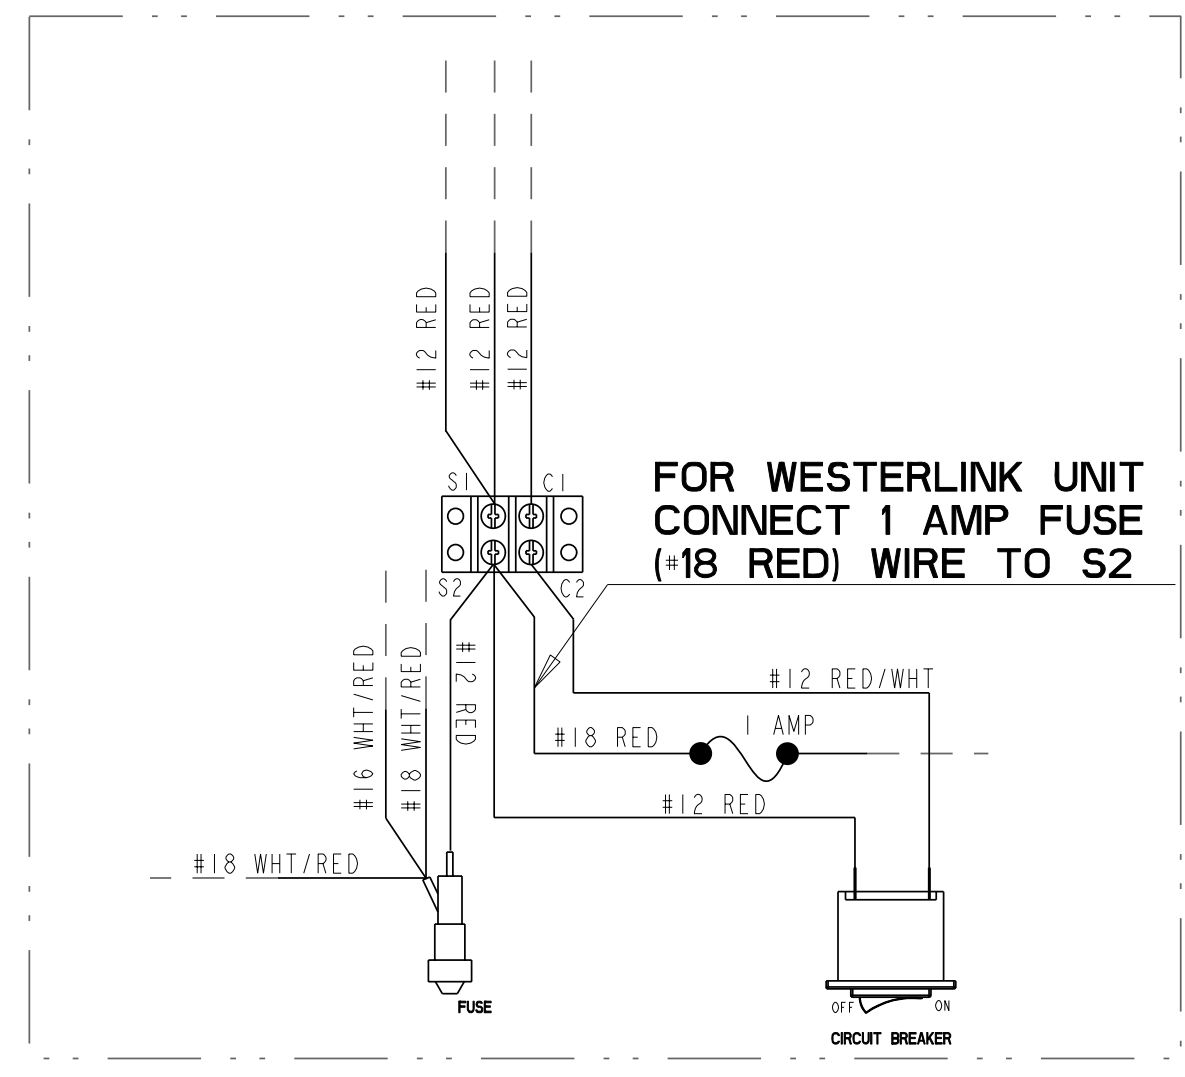

CONTROL BOX (DC SIDE)

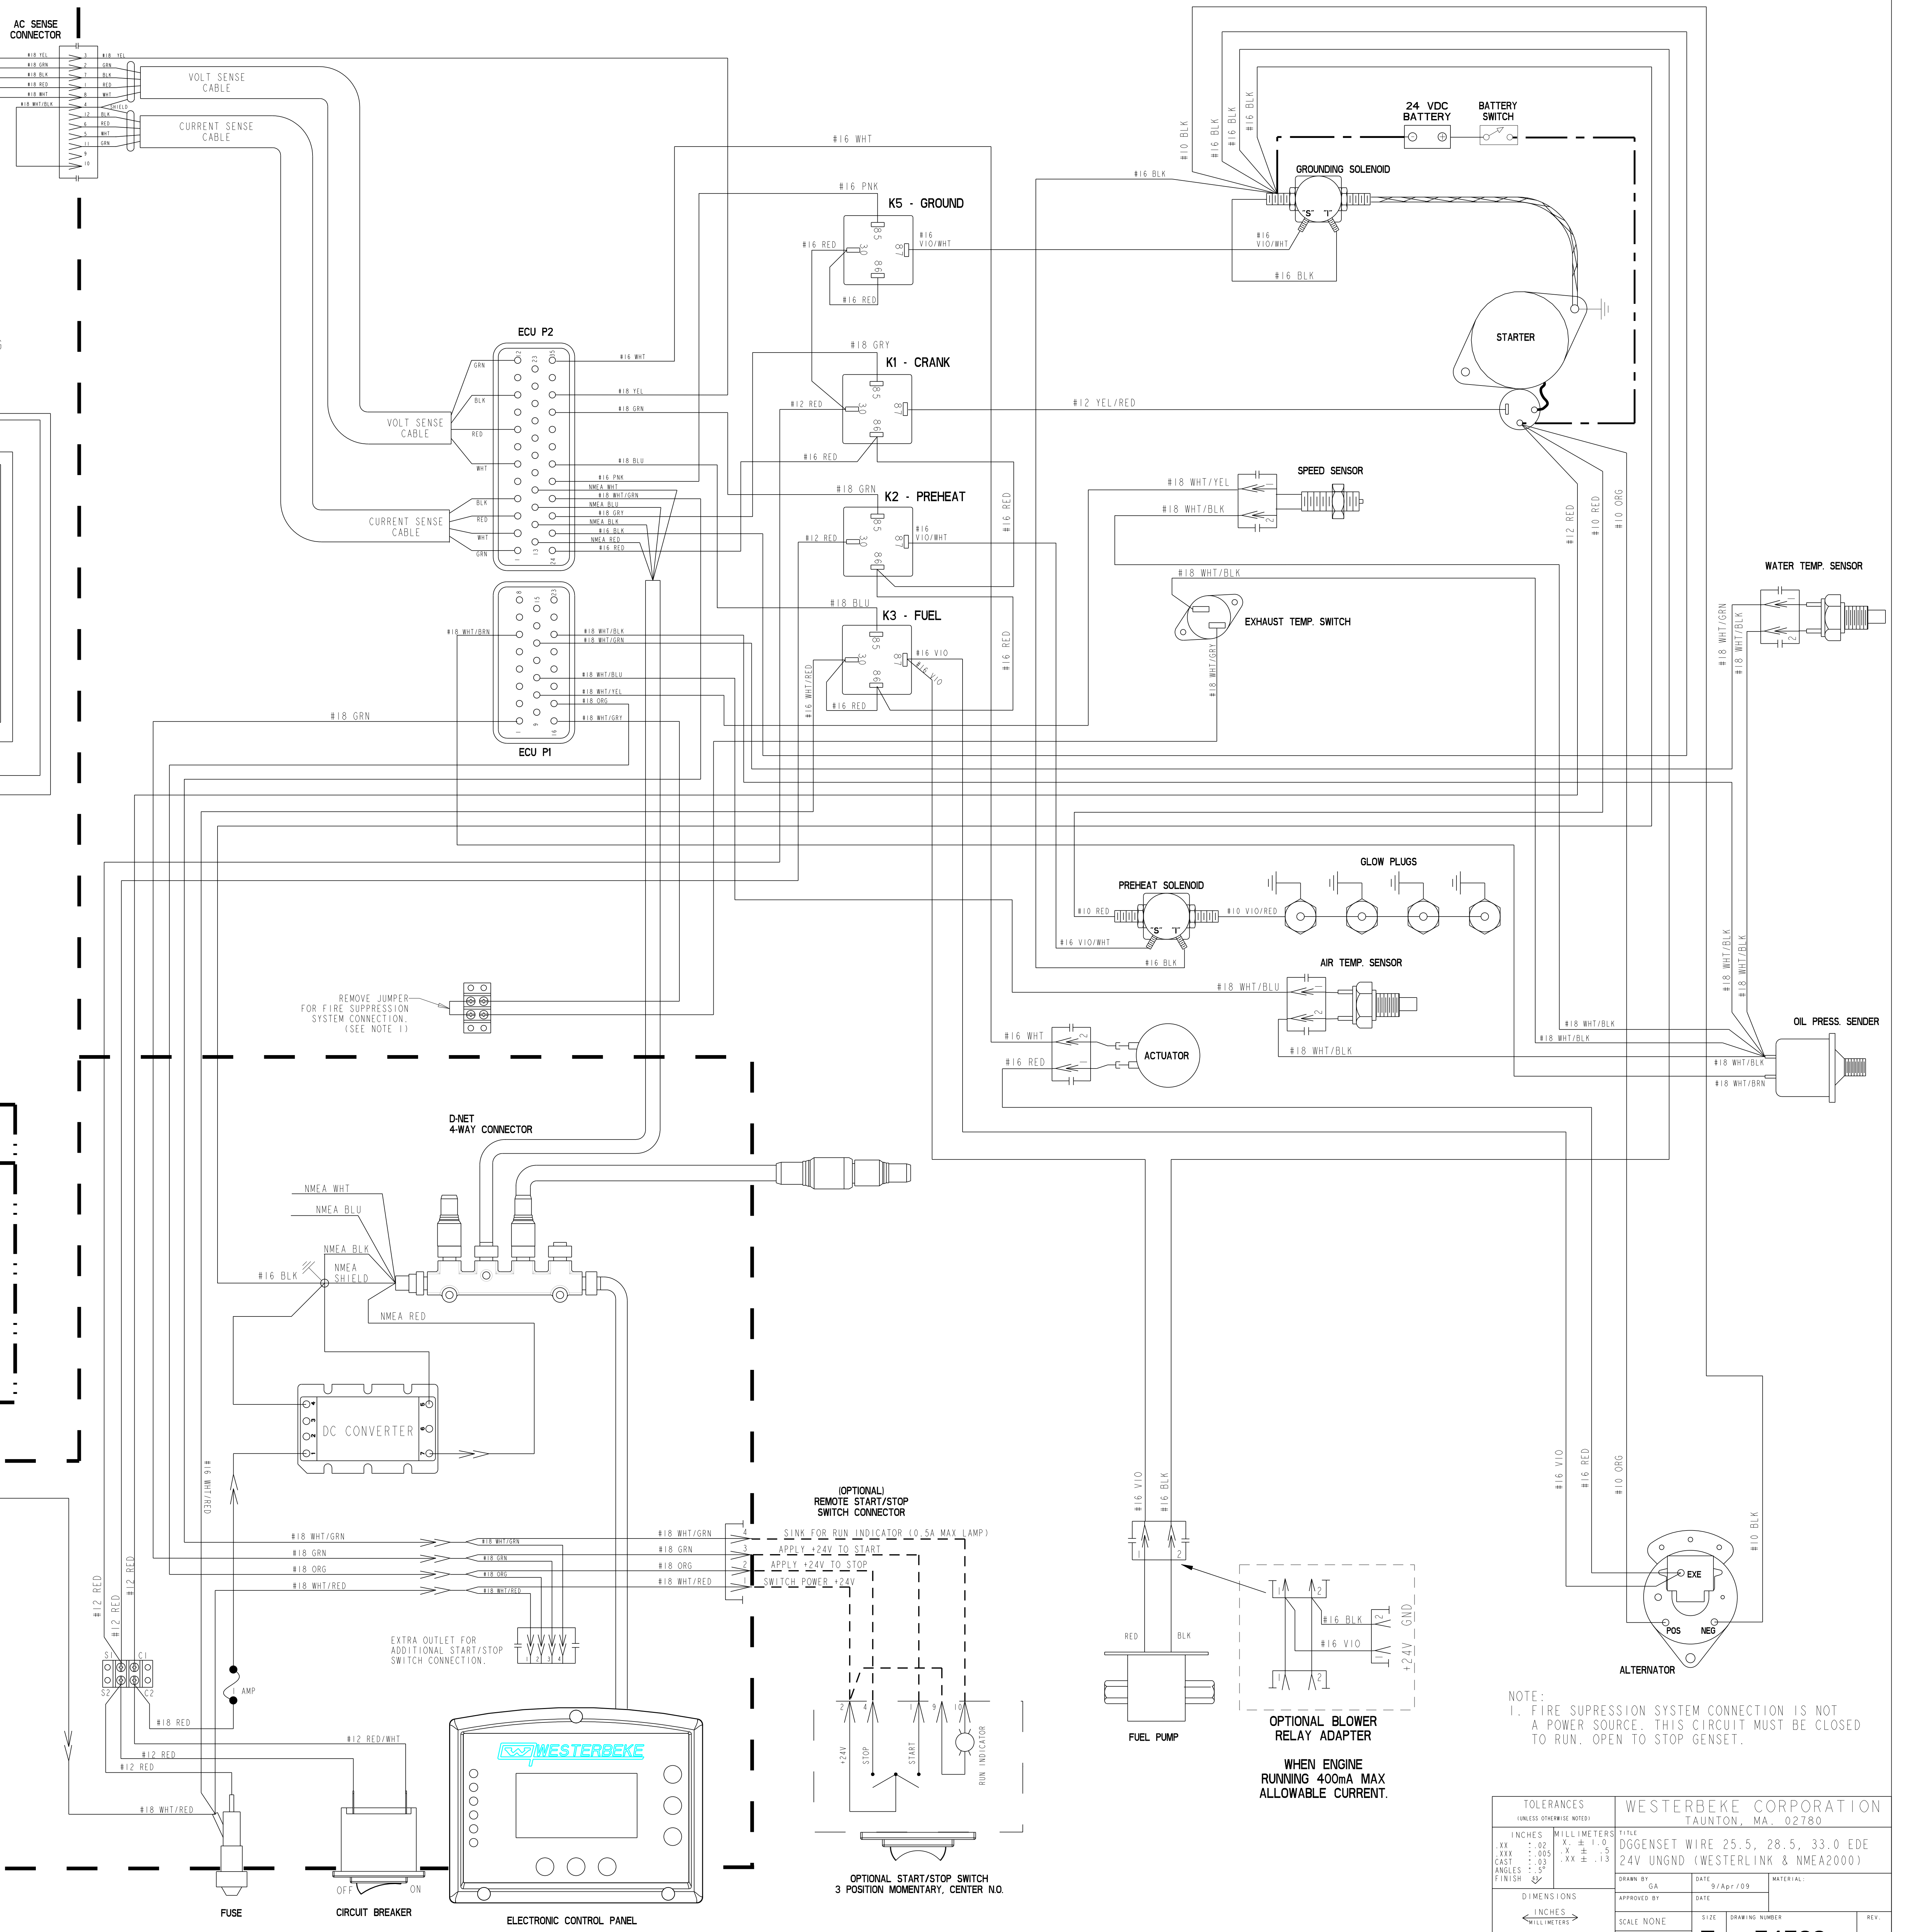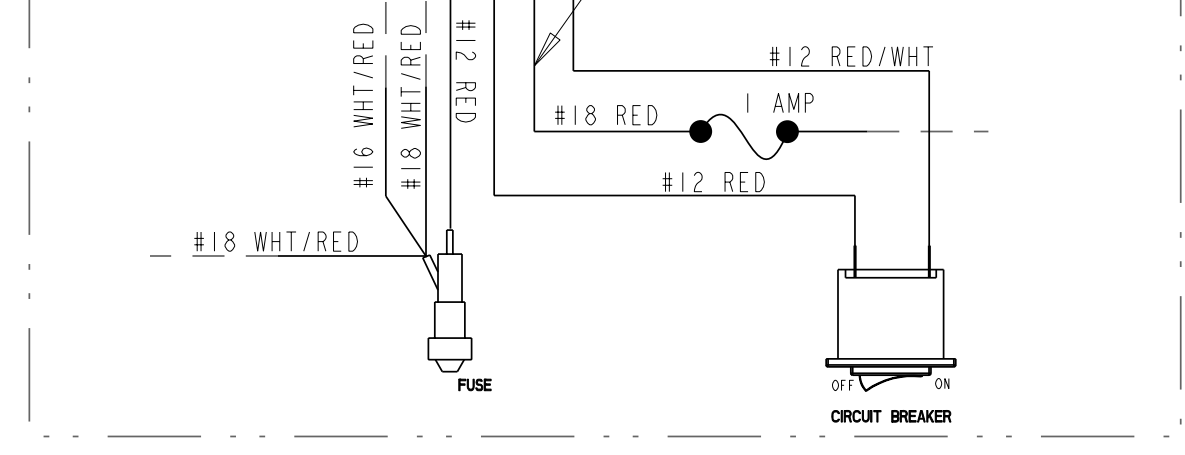

NOTE:
1. FIRE SUPPRESSION SYSTEM CONNECTION IS NOT A POWER SOURCE. THIS CIRCUIT MUST BE CLOSED TO RUN. OPEN TO STOP GENSET.

TOLERANCES (UNLESS OTHERWISE NOTED)		WESTERBEKE CORPORATION TAUNTON, MA 02780	
INCHES	MILLIMETERS	FILE	DGGENSET WIRE 25.5, 28.5, 33.0 EDE
XX	XX	XX	24V UNGND (WESTERLINK & NMEA2000)
CAST	CAST	XX	XX
FINISH	FINISH	XX	XX
DIMENSIONS (WHEN APPLICABLE)		APPROVED BY	DATE
SCALE NONE		DATE	9/Apr/09
SIZE		DRAWING NUMBER	
SHEET 1 OF 1		E 54533	