


ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY
6282	11-9	A	RELEASED TO SYSTEM.		GA
6289	12-8	B	ADDED 1 AMP FUSE, FIRE SUPPRESSION SYSTEM AND TERMINAL STRIPS TO THE WIRING DIAGRAM. ADDED OPTIONAL REMOTE S/S CONNECTION.		GA
6297	1-9	C	P2-PIN 24 WAS CONNECTED TO K1-PIN 86.		GA
6309	2-1	D	REROUTE K1-30 (16-RED) TO K1-86. REMOVE JUMPER WIRE (16-RED) BETWEEN K2-30 AND K3-30. REROUTE K3-86 (16-WHT/RED) TO K3-30. ADD JUMPER WIRE (16-RED) BETWEEN K3-30 AND K3-86. REROUTE K3-30 (12-RED) TO K2-30.		GA
6350	6-21	E	ADDED Y-ADAPTER, CHANGED K4 RELAY CONNECTION. ADDED OPTIONAL POWER SOURCE.		GA

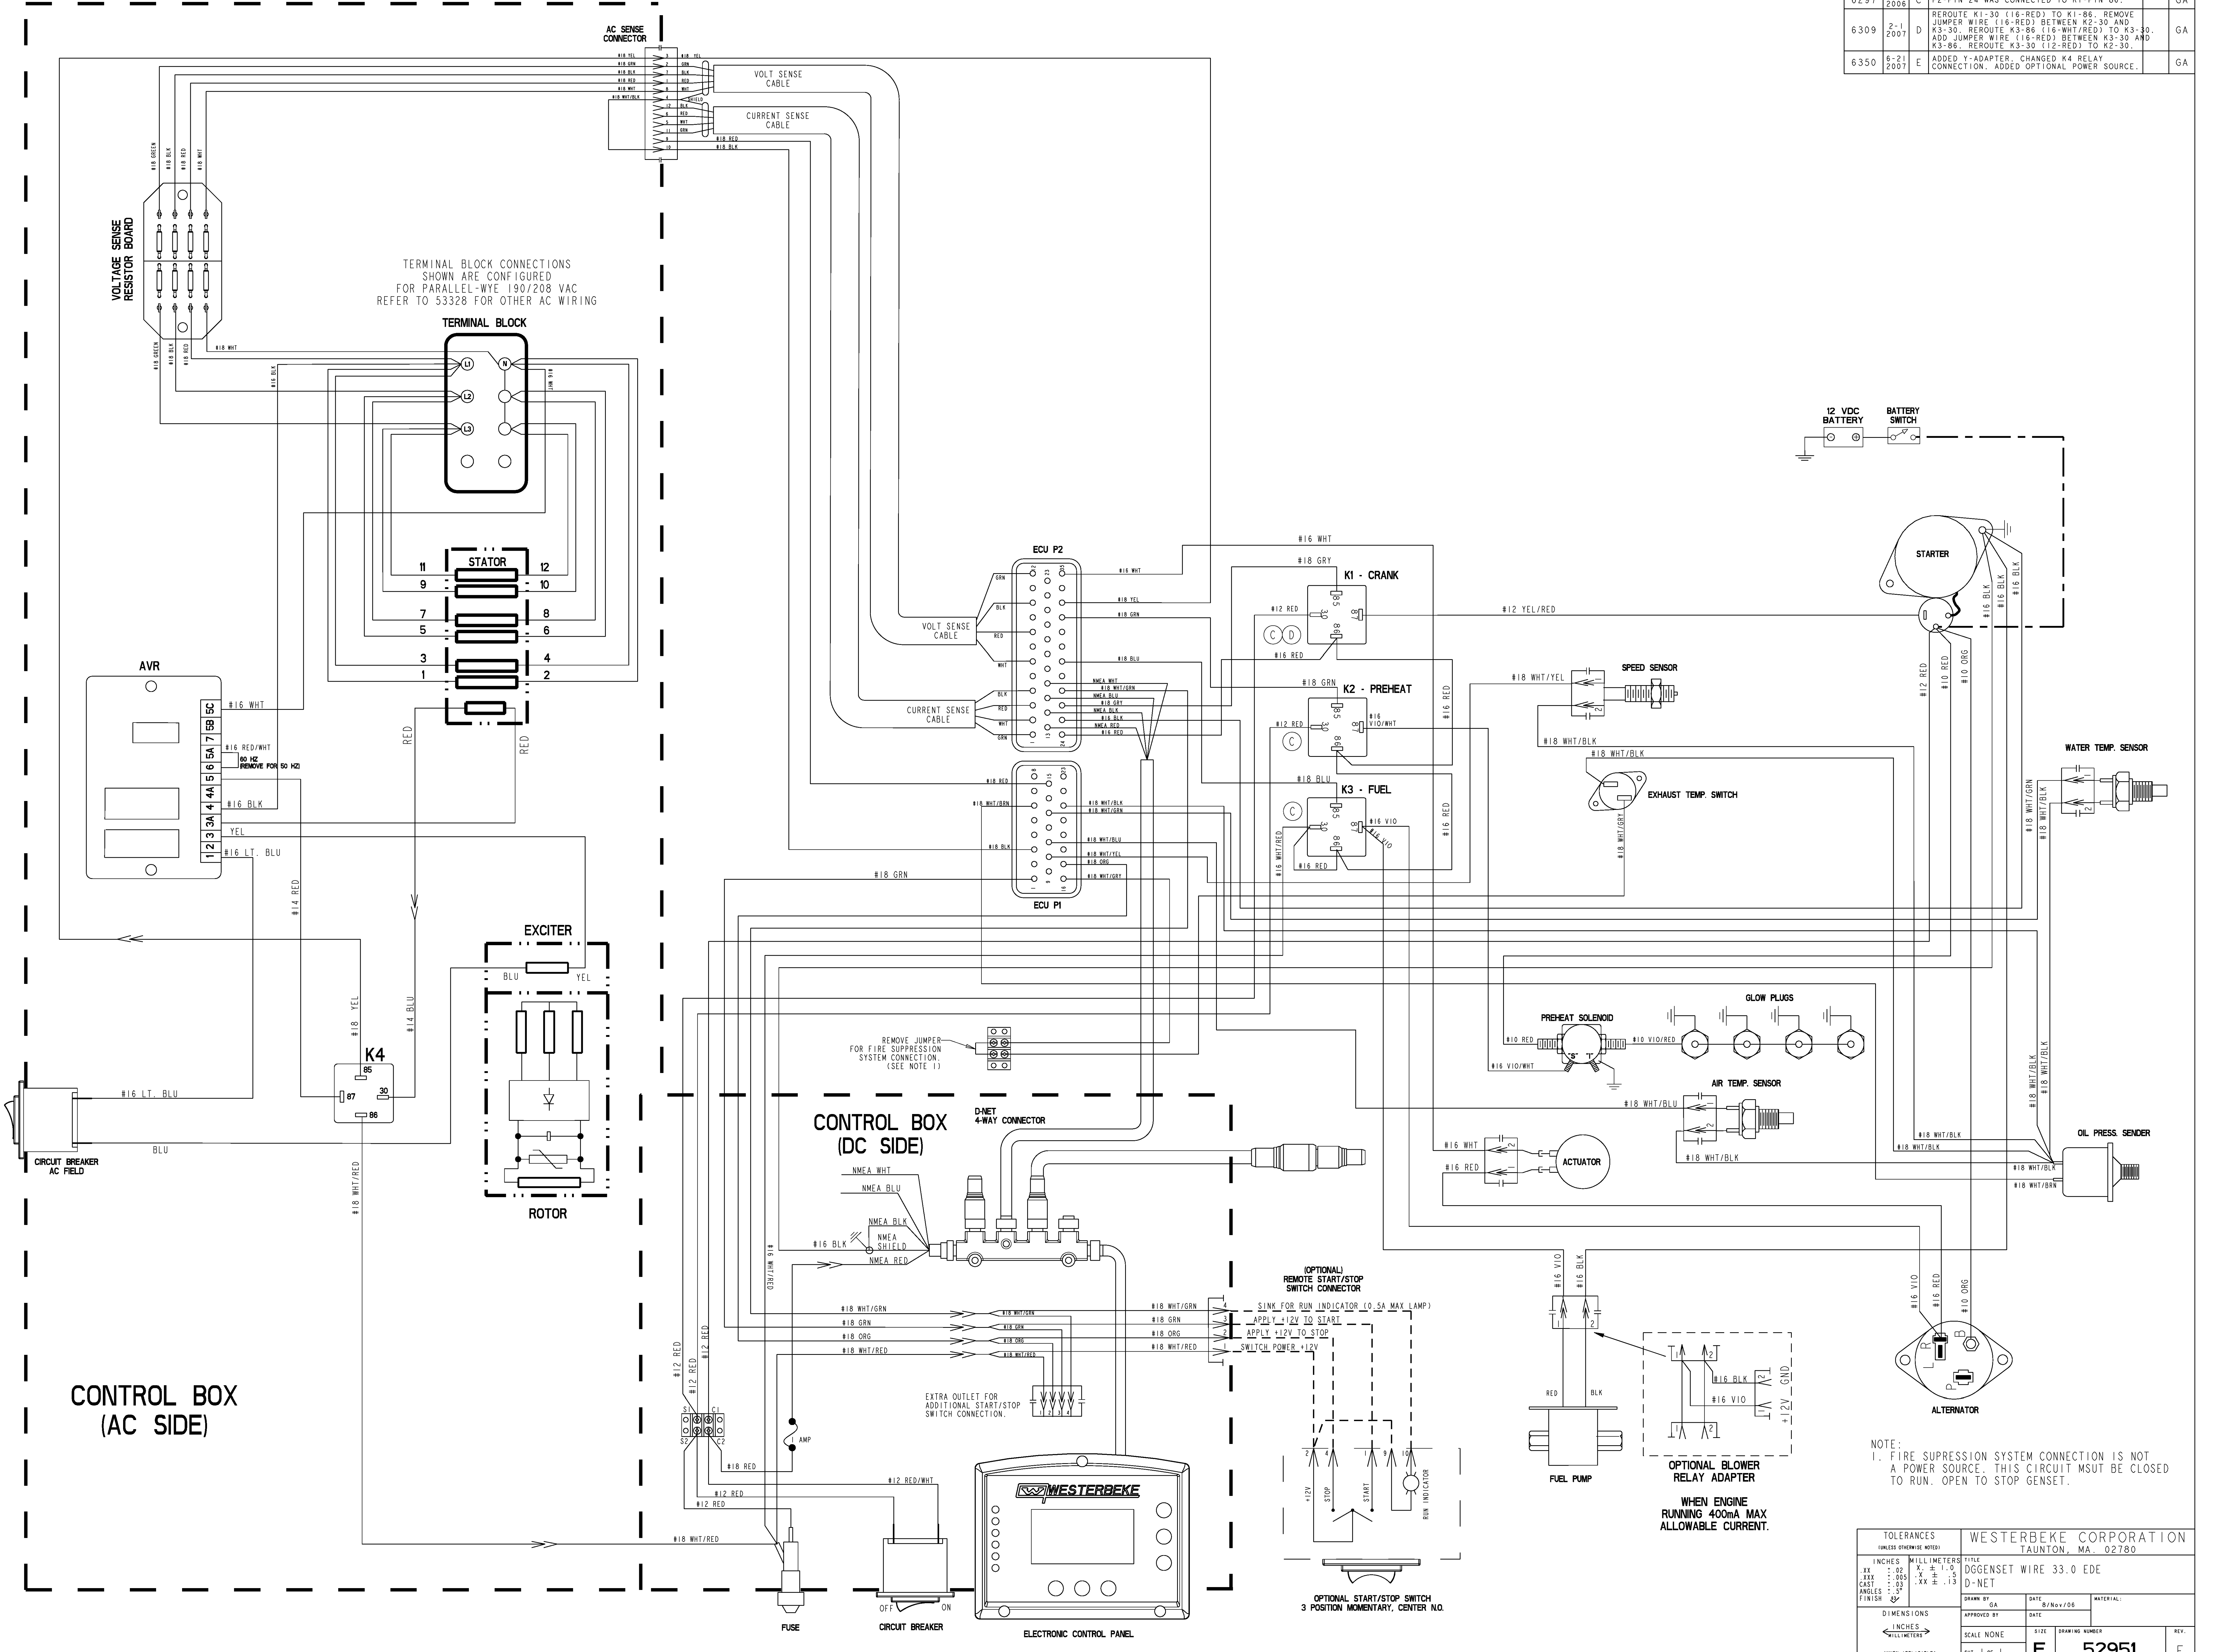

TOLERANCES (UNLESS OTHERWISE NOTED)		WESTERBEKE CORPORATION TAUNTON, MA. 02780	
INCHES	MILLIMETERS	FILE	DWGSET WIRE 33.0 EDE
.XX	.02	X	± 1.0
.XXX	.005	.XX	± .13
CAMST			
ANGLES	5°		
FINISH	3X		
DIMENSIONS	APPROVED BY	DATE	MATERIAL
INCHES	SCALE NONE	8/Nov/06	
MILLIMETERS	SIZE	DRAWING NUMBER	REV.
(WHEN APPLICABLE)	SHT. 1 of 1	E	52951