


NO.	REV.	DATE	REV.	REVISION	BY	CHK.
5741	18-3	2884	C	REPAIR SP-LICE CONNECTION FOR INJECTOR. DATE AND OXYGEN SENSOR TO REPRESENT HARNESS ROUTING.	GA	
5853	10-12	2441	D	ROLL BACK SP-LICE CONNECTION TO HOW IT CONNECTED IN REVISION 8.	GA	
5877	11-18	2424	E	SHOW PANEL BOX GROUND CONNECTION. UPDATED LED DISPLAY BOARD.	GA	

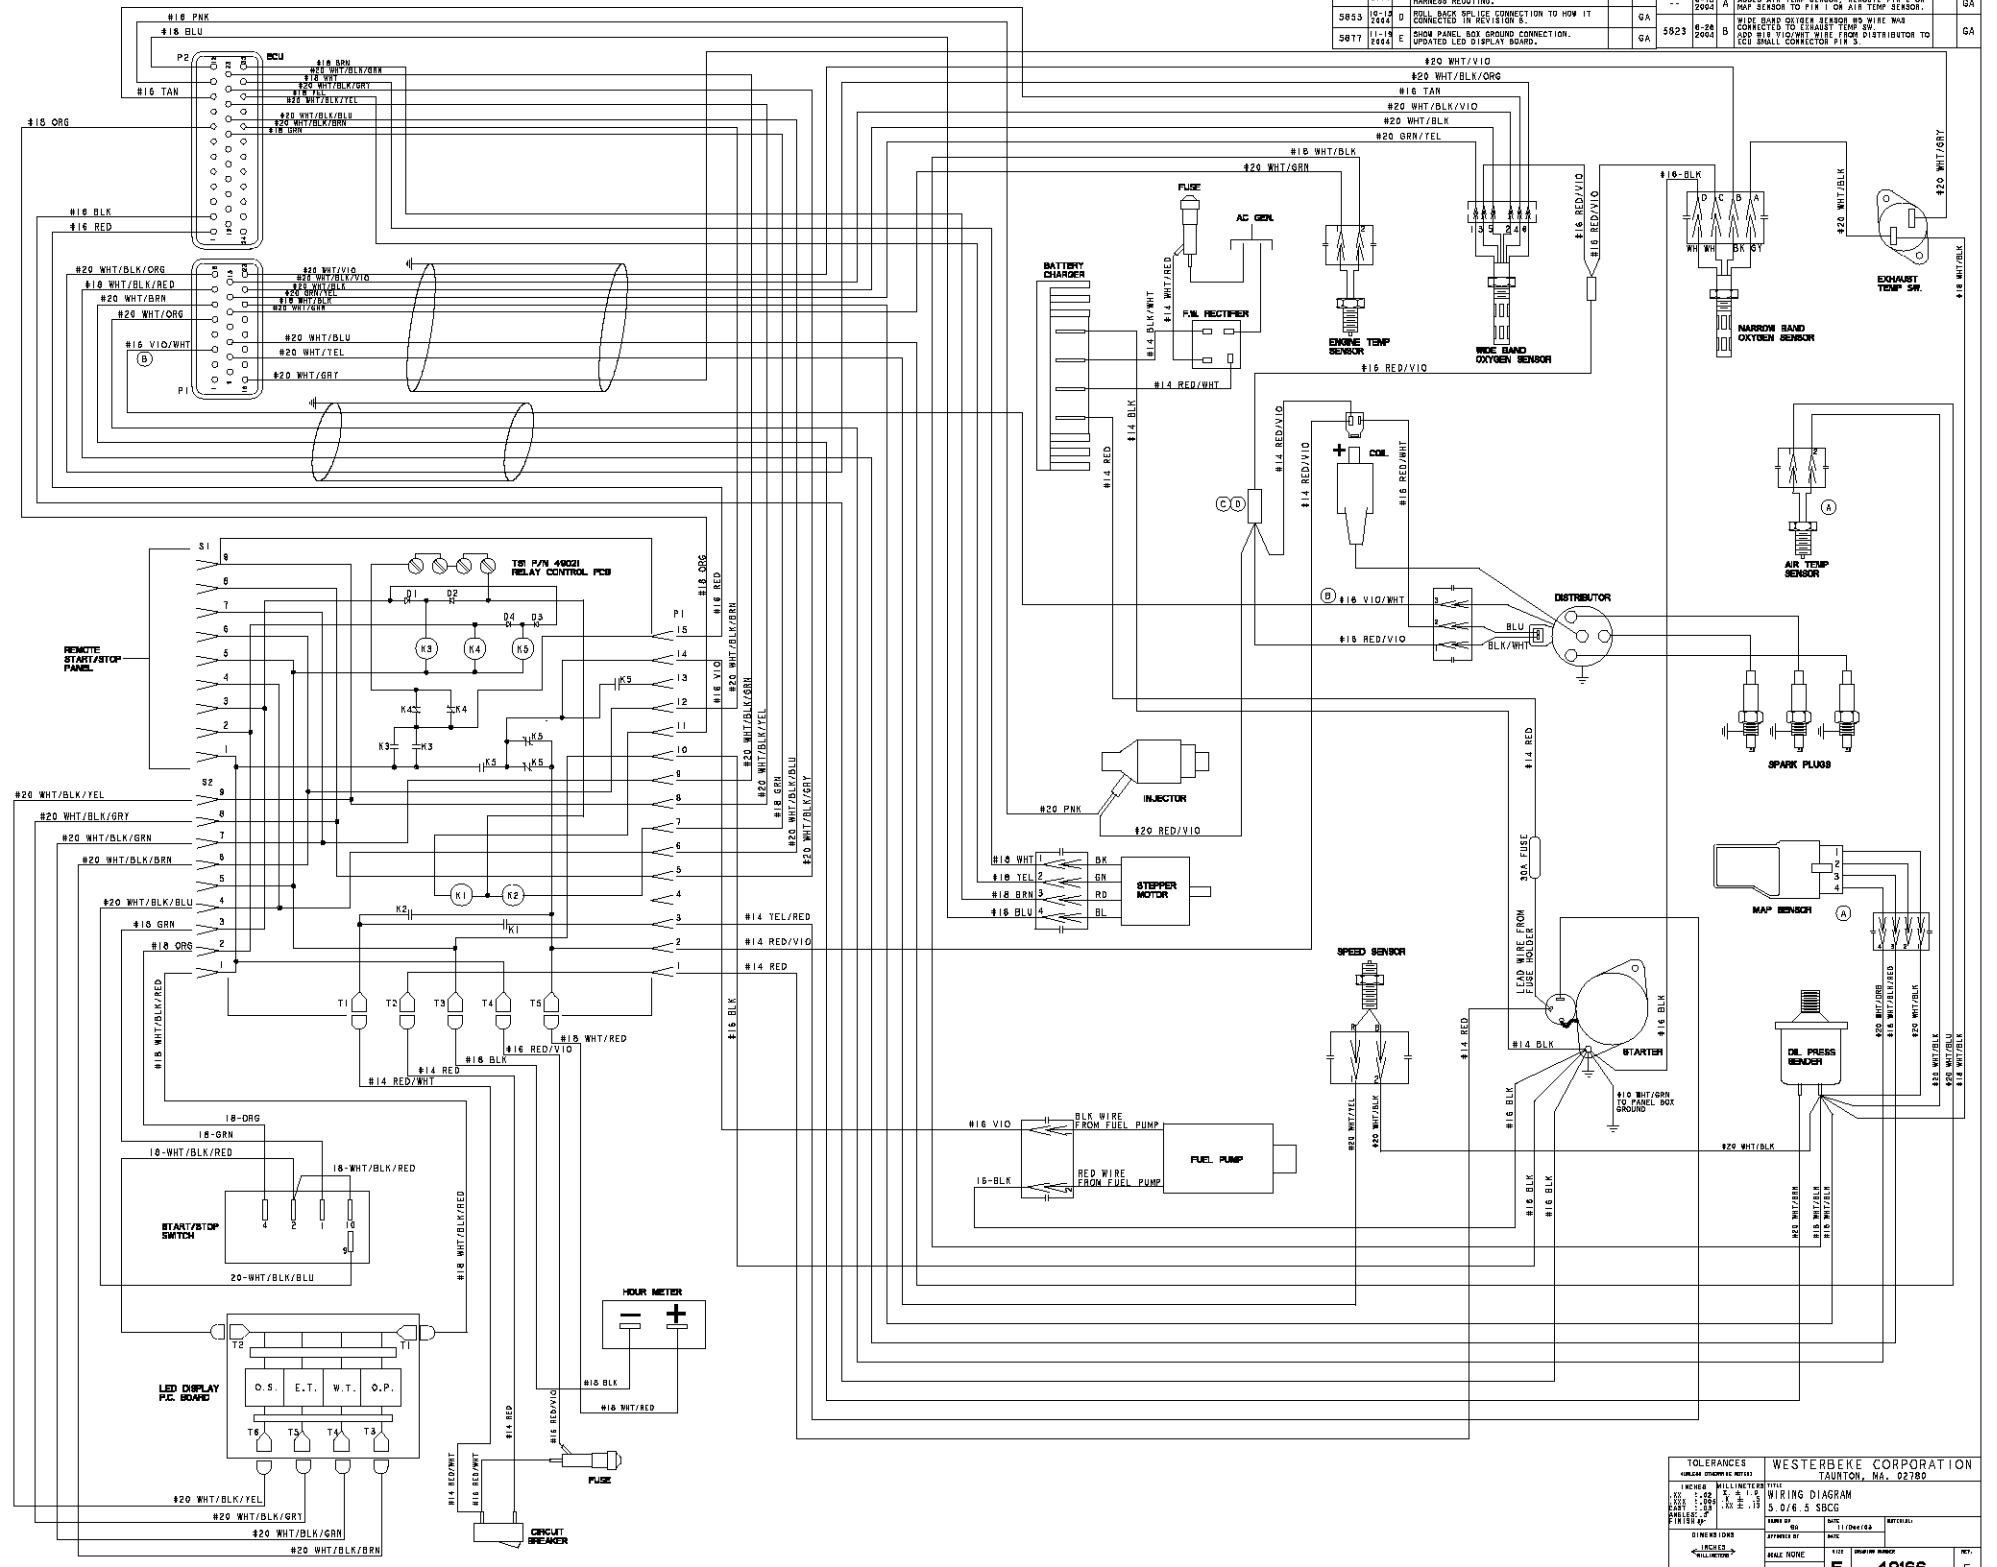

TOLERANCES		WESTERBEKE CORPORATION	
UNLESS OTHERWISE NOTED		TAUNTON, MA. 02780	
FRACTIONAL DECIMALS		WIRING DIAGRAM	
DECIMALS		5.0/6.5 SBCC	
PERCENTS			
DIMENSIONS			
DIAGRAM NO.	DATE	REV.	BY
APPROVED BY	DATE	APPROVED BY	DATE
SCALE	PROJ. NO.	REV.	DATE
E		49166	